



Compliant and noncompliant meter box locations

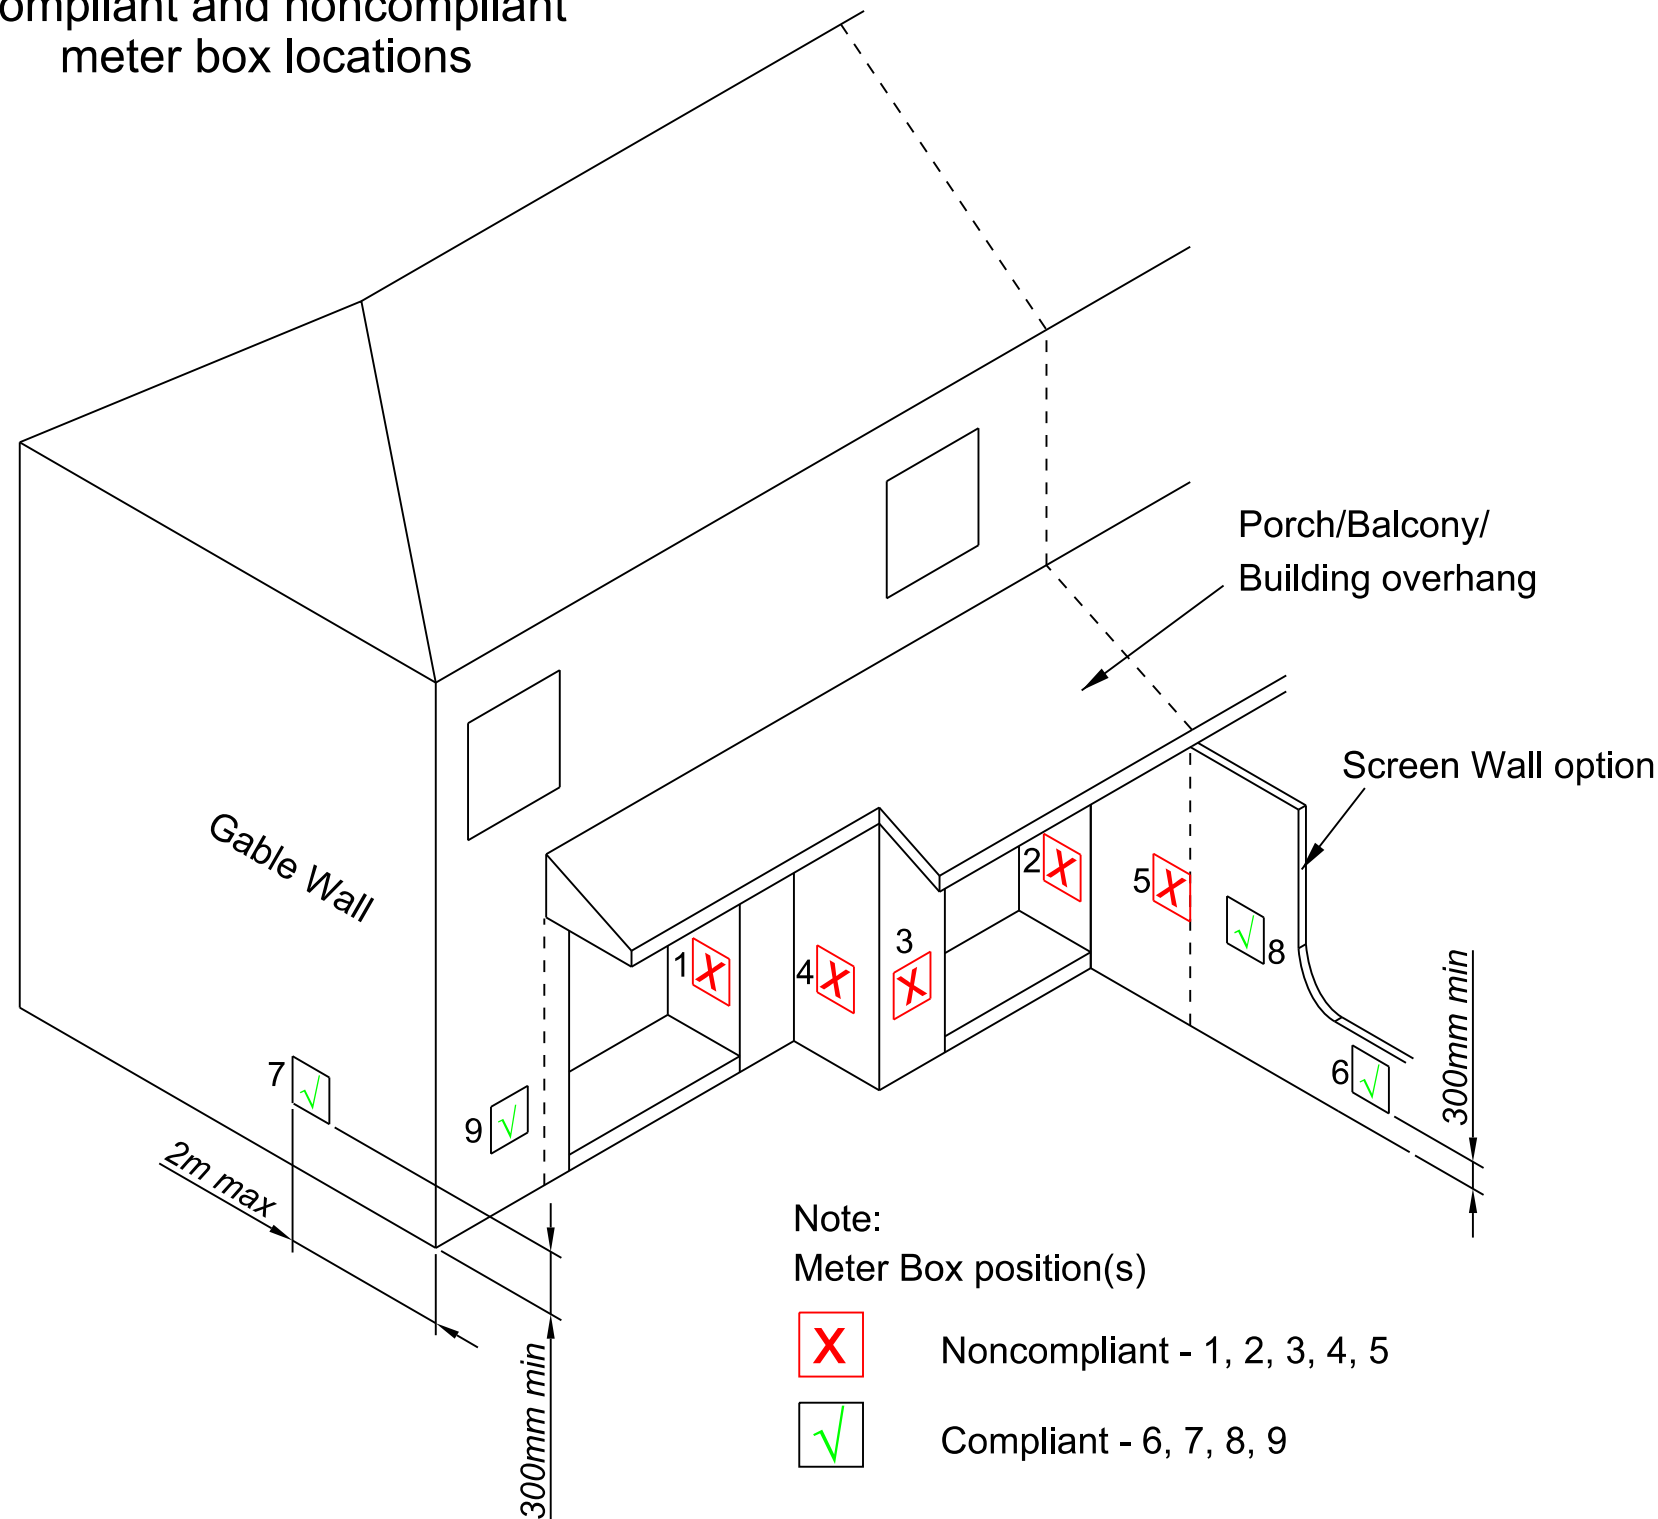

- Notes:
- Meter box is not permitted within a porch/building overhang.
 - A minimum separation of 300mm from the service pipe of the gas meter, to the service pipe of the ESB meter, is required.
 - A minimum separation of 150mm from the gas meter box, to the ESB meter box, is required.
 - A minimum separation of 400mm from the gas meter box, to an electrical distribution board, is required.
 - A minimum separation of 300mm from the service pipe of the gas meter, to any other services, is required.
 - Meter box shall be greater than 300mm away from a flue.
 - Meter box shall not be placed greater than 2 meters from the gable end of the property.
 - Meter and service installations shall be in accordance with I.S.813 and I.S.265.

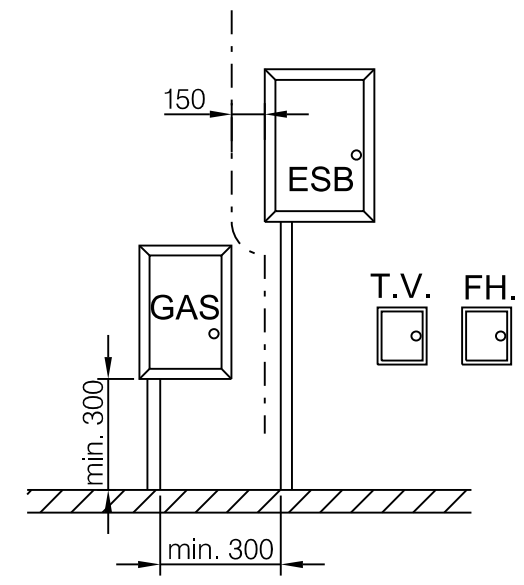

(All Dimensions in millimeters)

TYPICAL METER BOX POSITIONS

I CONFIRM THAT ALL GAS METER BOXES AND GAS SUPPLY PIPES SHALL BE INSTALLED IN ACCORDANCE WITH SK/701 AND ITS REQUIREMENTS .

NAME (BLOCK CAPITALS):

POSITION (BLOCK CAPITALS):

COMPANY (BLOCK CAPITALS):

SIGNED :

DATE:

ISSUE	DATE	REVISION	DRAWN	APPROV.
12	24/3/16	Text Revisions	KD	AT
11	8/3/16	Generally Revised	KD	AT
10	22/07/15	Meter box detail revised	KM	AT



NETWORK SERVICE CENTRE,
ST MARGARET'S ROAD, FINGLAS
DUBLIN 11.

Tel: (01) 8926000 Fax: (01) 8926001

PROJECT / TITLE						
Compliant and noncompliant meter box locations						
Scale	Date	Drawn	Checked	Drawing Number	Project Number	SHEET
NTS	12/03/15	KM	KL	SK/701		1
						OF
						1